


STANDARD DETAILS & SPECIFICATIONS

SUBJECT: Specifications for the installation of bollards for private fire protection equipment, generators, and fuel tanks


| | |
|-------------|--------------------|
| Spec. No. | <u>CFMO-C1</u> |
| Rev. Date | <u>7/1/2003</u> |
| Eff. Date | <u>9/4/96</u> |
| Approved By | <u>J. Saunders</u> |
| Page 1 | <u>of 1</u> |

BOLLARD DETAIL

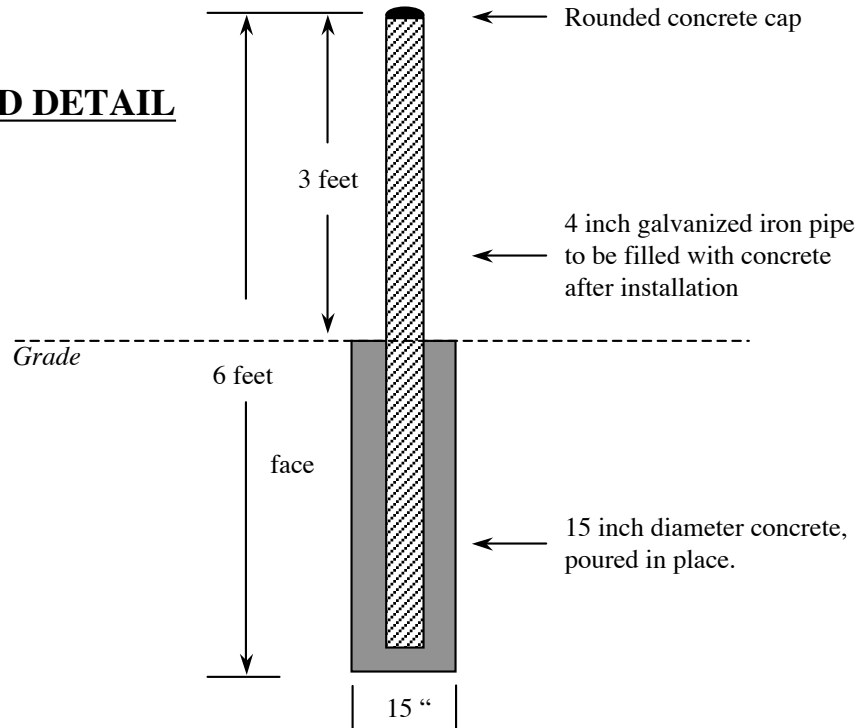


HYDRANT POST LOCATIONS

Bollards shall be **three (3)** feet minimum from the face of fire hydrant. All orifices shall be unobstructed.

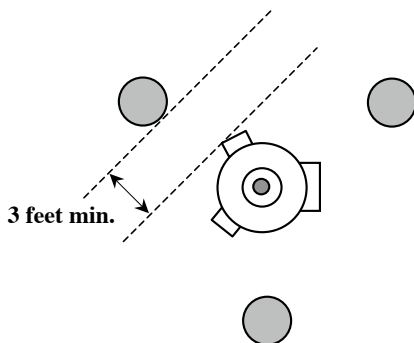

GENERATOR/FUEL TANK POST LOCATIONS

Bollards shall be **five (5)** feet minimum from the face of fire hydrant.

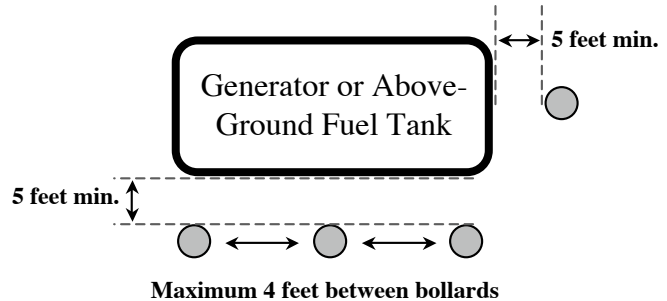

NOTE: The installation of bollards for public fire hydrants requires approval from the public water company.